


All dimensions are approximate. For exact dimensions contact your dealer.

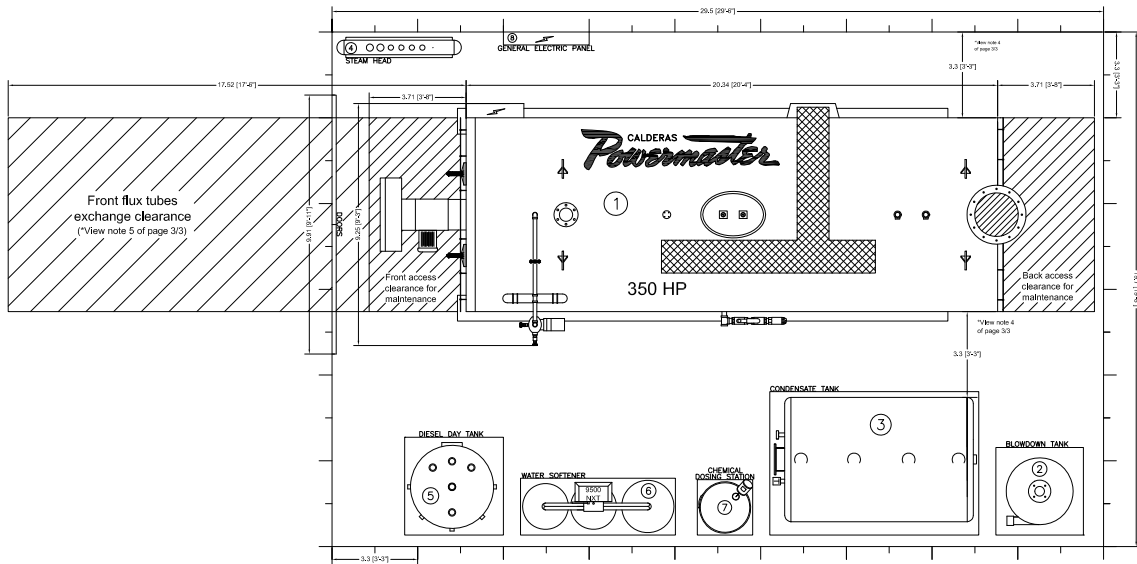

Termodinamica Eolica, S.A. de C.V. reserves the right to make changes in this document without notice.

EQUIPMENTS FOR STEAM GENERATION

- ① Steam Powermaster Boiler WB-A2-3P 350 HP
- ② Blowdown Separator Tank TPG-400
- ③ Condensate Tank TCC-N500
- ④ Steam head *
- ⑤ Diesel day tank TT1-900 CB
- ⑥ Water softener PW2x7F 9500NX/1.5
- ⑦ Chemical dosing station *
- ⑧ General electric panel *



Note: The LAYOUT shown here is typical. The geometry and minimum space required depends on the desired accommodation and purchased equipment. If you require a detailed LAYOUT of your budget, contact your dealer.

		* Check dimensions with your dealer Termodinamica Eolica S.A. de C.V. <small>4000 Calle Industrial, Ciudad de los Reyes, Jalisco Avda. 1 de los 300, Col. Hacienda de Valle Encarnado, Alameda de Zaragoza, C.P. 46100, Jalisco</small>	
		Powermaster WB-A2-3P 350 HP	
MODEL NO. ft (ft-in)	PRICE	LAYOUT	FINANCE
PAGE 1 / 3	WEIGHT HEAVY OIL, LIGHT OIL, GAS, DUAL	REFER TO SALES DEPT.	FINANCING BY ING. J. NOTHOLT
DRAWN BY ING. J. CHAPARRO			

GENERAL NOTES


1. Powermaster recommends to use foundation bases for the boilers. View detail "A"
2. The Powermaster boilers don't need be anchored to the floor.
3. The arrangement suggested here, can be modified to suit different geometries.
4. Powermaster recommends a distance between the pressure container and another equipment or wall of minimum 3.3 ft.
5. The space for flux tubes exchange clearance is requires only 1 time per year or less.
6. The save valves must be calibrated to the boiler design pressure.
7. Powermaster recommends to use black carbon steel pipes schedule 40 or 80 except the local norm applicable.
8. The water temperature in the receptor condensate tank have to be minimum 176°F.
9. The water softener equipment must to make up with filtered water. Check with the manufacturer the adequate pressure.
10. When steam is feed to condensate tank it must be feed to low pressure (Maximum 26 PSI) for reduce the noise.
11. It must to install a Barometric draft regulator when the height smokestack is greater than 26.2 ft. Powermaster recommend to install straight smokestacks and independently.
12. When it can't install independent smokestack, view detail "C".
13. It must to install a ground to the electric panel.
14. The download of safe valves must be with black carbon steel pipes schedule 40 and vent outdoor.
15. Install independent switch thermomagnetic for each boiler. Check with your dealer the capacity switch.
16. The safe valves numbers depends of size boiler. Please check with your dealer.
17. The boiler burner has to be feeded with filtered gas to constant pressure, it has to install an appropriate gas pressure regulator for the fluid and the required pressure (check with the manufacturer). The regulator has to be exclusively for the boiler burner and Powermaster recommends have a relief valve calibrated to the maximum permissible pressure (consult with the manufacturer).
18. In Diesel boilers must be install a return diesel line. The line have to be independent for each boiler and without accessories like valves, filters, etc.
19. The drain line of diesel tank must be send to hazardous waste container.
20. The vent of diesel day tank must be have with height that exceeding the maximum height of the principal diesel tanks.
21. All the equipments indicated in this LAYOUT must be install inside the ventilated machine room. The equipments must not be outdoor.
22. Powermaster recommend build trenches inside the machine room for a well distribution pipes. Suggested Trench (View detail "B").

All dimensions are approximate; for exact dimensions contact your dealer.

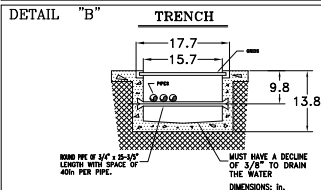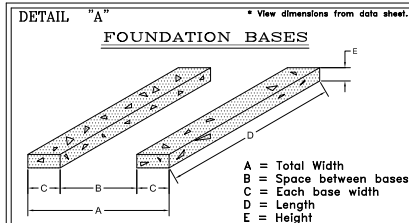

DETAIL "C"

TYPICAL INSTALLATION OF COMMON SMOKESTACKS



		<small>* Check dimensions with your dealer</small>	
Calderas Powermaster		Termodinámica Enica S.A. de C.V. <small>1998 Calle Industrial, Ciudad de México, México Edif. 3 de las Ulas, Cd. Hacienda de Valle Guadalupe, Av. de la Reforma, Estado de México, CP. 04501. T. 52-55-551-1818</small>	
Powermaster WB-A2-3P 350 HP			
REVISIONES:	In	PROYECTO:	FORNIDOR:
PREC:	3 / 3	DESC:	LAYOUT
REVISOR:	ING. J. CHAPARRO	REVISOR:	HEAVY OIL, LIGHT OIL, GAS, DUAL
		MONITOREO:	SALES DEPT.
			ING. J. NOTHOLT