


All dimensions are approximate, for exact dimensions contact your dealer.

Termodinámica Enica S.A. de C.V. reserves the right to make changes to this document without notice.

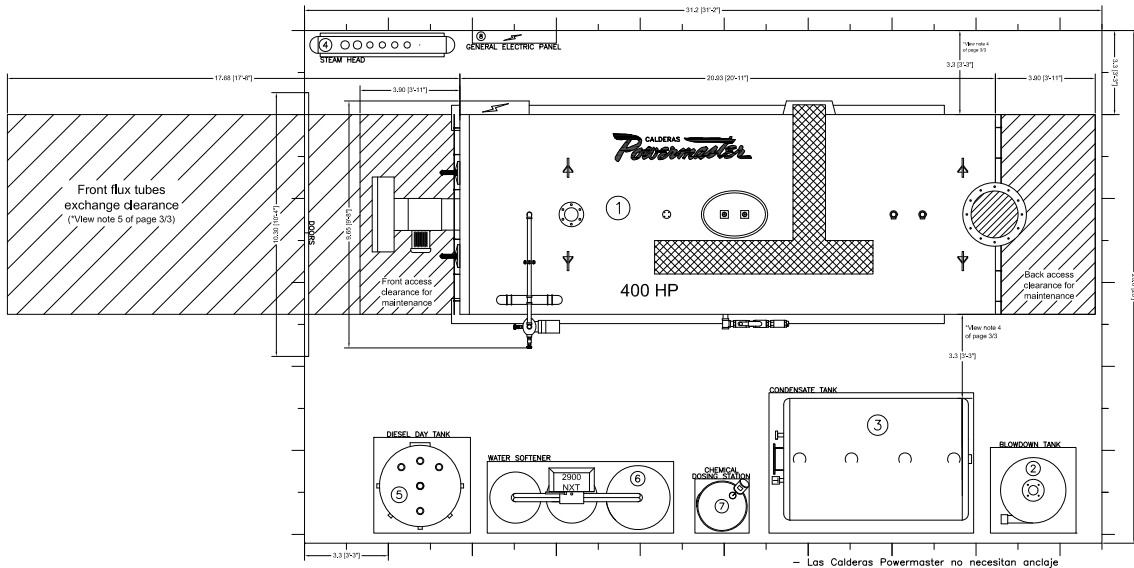


EQUIPMENTS FOR STEAM GENERATION

- ① Steam Powermaster Boiler WB-A2-3P 400 HP
- ② Blowdown Separator Tank TPG-400
- ③ Condensate Tank TCC-N500
- ④ Steam head *
- ⑤ Diesel day tank TT1-900 CB
- ⑥ Water softener PW2x10F 2900NXT/2
- ⑦ Chemical dosing station *
- ⑧ General electric panel *

Note: The LAYOUT shown here is typical. The geometry and minimum space required depends on the desired accommodation and purchased equipment. If you require a detailed LAYOUT of your budget, contact your dealer.

		* Check dimensions with your dealer Termodinámica Enica S.A. de C.V. <small>Rolul Street, Colonia Centro de Veracruz</small> Blvd. 3 de Mayo, Cd. Nacional de Valle Ecatepec, Municipio de Santiago, Estado de México, C.P. 06001. T. 52 55 55 12 68 88 88	
		Model: Powermaster WB-A2-3P 400 HP	
MODEL NO. ft (ft-in)	PRICE 1 / 3	SPECIES LAYOUT HEAVY OIL, LIGHT OIL, GAS, DUAL	FINANCE N/A
DRAWN BY ING. J. CHAPARRO	REVIEWED BY SALES DEPT.	MANUFACTURED BY ING. J. NOTHOLT	

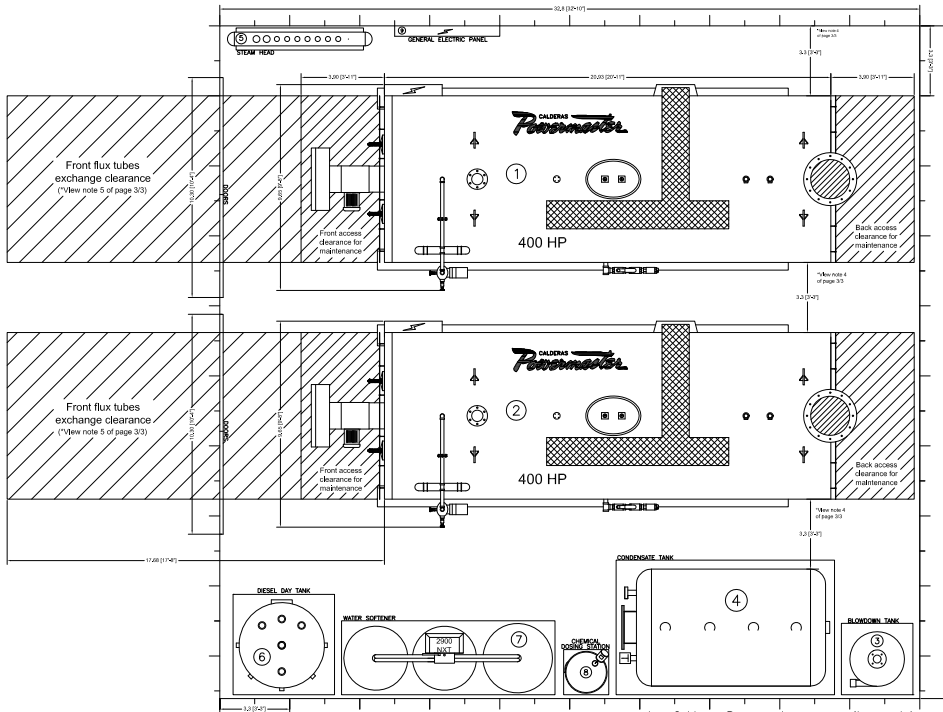

EQUIPMENTS FOR STEAM GENERATION

- ① Steam Powermaster Boiler WB-A2-3P 400 HP
- ② Steam Powermaster Boiler WB-A2-3P 400 HP
- ③ Blowdown Separator Tank TPG-400
- ④ Condensate Tank TCC-N800
- ⑤ Steam head *
- ⑥ Diesel day tank TT1-1900 CB
- ⑦ Water softener PW2x20F2900NX/2
- ⑧ Chemical dosing station *
- ⑨ General electric panel *

Note: The LAYOUT shown here is typical. The geometry and minimum space required depends on the desired accommodation and purchased equipment. If you require a detailed LAYOUT of your budget, contact your dealer.



— Las Calderas Powermaster no necesitan anclaje

		* Check dimensions with your dealer Termodinámica Elica S.A. de C.V. <small>Boiler design and construction since 1950</small> Edif. 316-114, Col. Hacienda de Valle Escobedo, Av. de la Reforma, Estado de México, CP 04601 T. 52-55-551-0248-0249	
		Powermaster WB-A2-3P 400 HP	
MODEL NO. ft (ft-in) SIZE 2 / 3 DRAWN BY ING. J. CHAPARRO	PROJECT LAYOUT SHEET NO. HEAVY OIL, LIGHT OIL, GAS, DUAL REVISIONS SALES DEPT.	MODEL NO. FT/INCH N/A NO. OF SHEETS ING. J. NOTHOLT	

GENERAL NOTES


1. Powermaster recommends to use foundation bases for the boilers. View detail "A"
2. The Powermaster boilers don't need be anchored to the floor.
3. The arrangement suggested here, can be modified to suit different geometries.
4. Powermaster recommends a distance between the pressure container and another equipment or wall of minimum 3.3 ft.
5. The space for flux tubes exchange clearance is requires only 1 time per year or less.
6. The save valves must be calibrated to the boiler design pressure.
7. Powermaster recommends to use black carbon steel pipes schedule 40 or 80 except the local norm applicable.
8. The water temperature in the receptor condensate tank have to be minimum 176°F.
9. The water softener equipment must to make up with filtered water. Check with the manufacturer the adequate pressure.
10. When steam is feed to condensate tank it must be feed to low pressure (Maximum 26 PSI) for reduce the noise.
11. It must to install a Barometric draft regulator when the height smokestack is greater than 26.2 ft. Powermaster recommend to install straight smokestacks and independently.
12. When it can't install independent smokestack, view detail "C".
13. It must to install a ground to the electric panel.
14. The download of safe valves must be with black carbon steel pipes schedule 40 and vent outdoor.
15. Install independent switch thermomagnetic for each boiler. Check with your dealer the capacity switch.
16. The safe valves numbers depends of size boiler. Please check with your dealer.
17. The boiler burner has to be feeded with filtered gas to constant pressure, it has to install an appropriate gas pressure regulator for the fluid and the required pressure (check with the manufacturer). The regulator has to be exclusively for the boiler burner and Powermaster recommends have a relief valve calibrated to the maximum permissible pressure (consult with the manufacturer).
18. In Diesel boilers must be install a return diesel line. The line have to be independent for each boiler and without accessories like valves, filters, etc.
19. The drain line of diesel tank must be send to hazardous waste container.
20. The vent of diesel day tank must be have with height that exceeding the maximum height of the principal diesel tanks.
21. All the equipments indicated in this LAYOUT must be install inside the ventilated machine room. The equipments must not be outdoor.
22. Powermaster recommend build trenches inside the machine room for a well distribution pipes. Suggested Trench (View detail "B").

All dimensions are approximate; for exact dimensions contact your dealer.

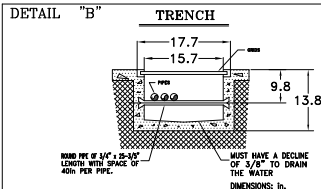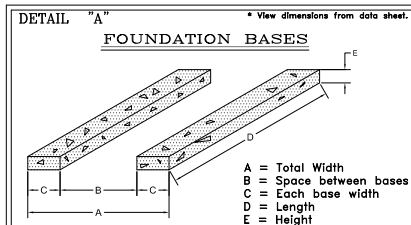

DETAIL "C"

TYPICAL INSTALLATION OF COMMON SMOKESTACKS



* Check dimensions with your dealer

CALDERAS		Powermaster	
Termodinámica Enica S.A. de C.V.		Termodinámica Enica S.A. de C.V.	
P.O. Box 1000, Mexico City, Mexico		P.O. Box 1000, Mexico City, Mexico	
Rd. 13 de Hna. Cd. Hacienda de Valle Escobedo,		Rd. 13 de Hna. Cd. Hacienda de Valle Escobedo,	
Aviación de Benito Juárez, Estado de México, CP 04601,		Aviación de Benito Juárez, Estado de México, CP 04601,	
Tel: 52-55-521-1282		Tel: 52-55-521-1282	
Powermaster WB-A2-3P 400 HP			
MODEL NUMBER:	In	PROCESS:	FORCED
SIZE:	3 / 3	LAYOUT:	N/A
DESIGNED BY:	ING. J. CHAPARRO	ENGINEERED BY:	ING. J. NOTHOLT
SALES DEPT.		SALES DEPT.	